


**NOTE:**

- GRINDER PUMP MUST BE AT LEAST 10 FEET FROM FOUNDATION.
- ALL COMPRESSION FITTINGS WILL BE BRASS OR STAINLESS STEEL.
- ALL CURB STOP EXTENSION RODS SHALL BE STAINLESS STEEL.
- HDPE/POLY PIPE REQUIRES THE USE OF STAINLESS STEEL INSERT PIPE STIFFENERS FOR ALL PACK JOINT/COMPRESSION CONNECTIONS.
- STAINLESS STEEL OR BRASS DRESSER COUPLINGS TO BE USED WHERE EXISTING LINE IS CUT FOR TEE.
- ALL SANITARY SEWER LINES SHALL BE AT A DEPTH OF 5' OR GREATER. IF LESS THAN 5' LINE SHALL BE INSULATED.

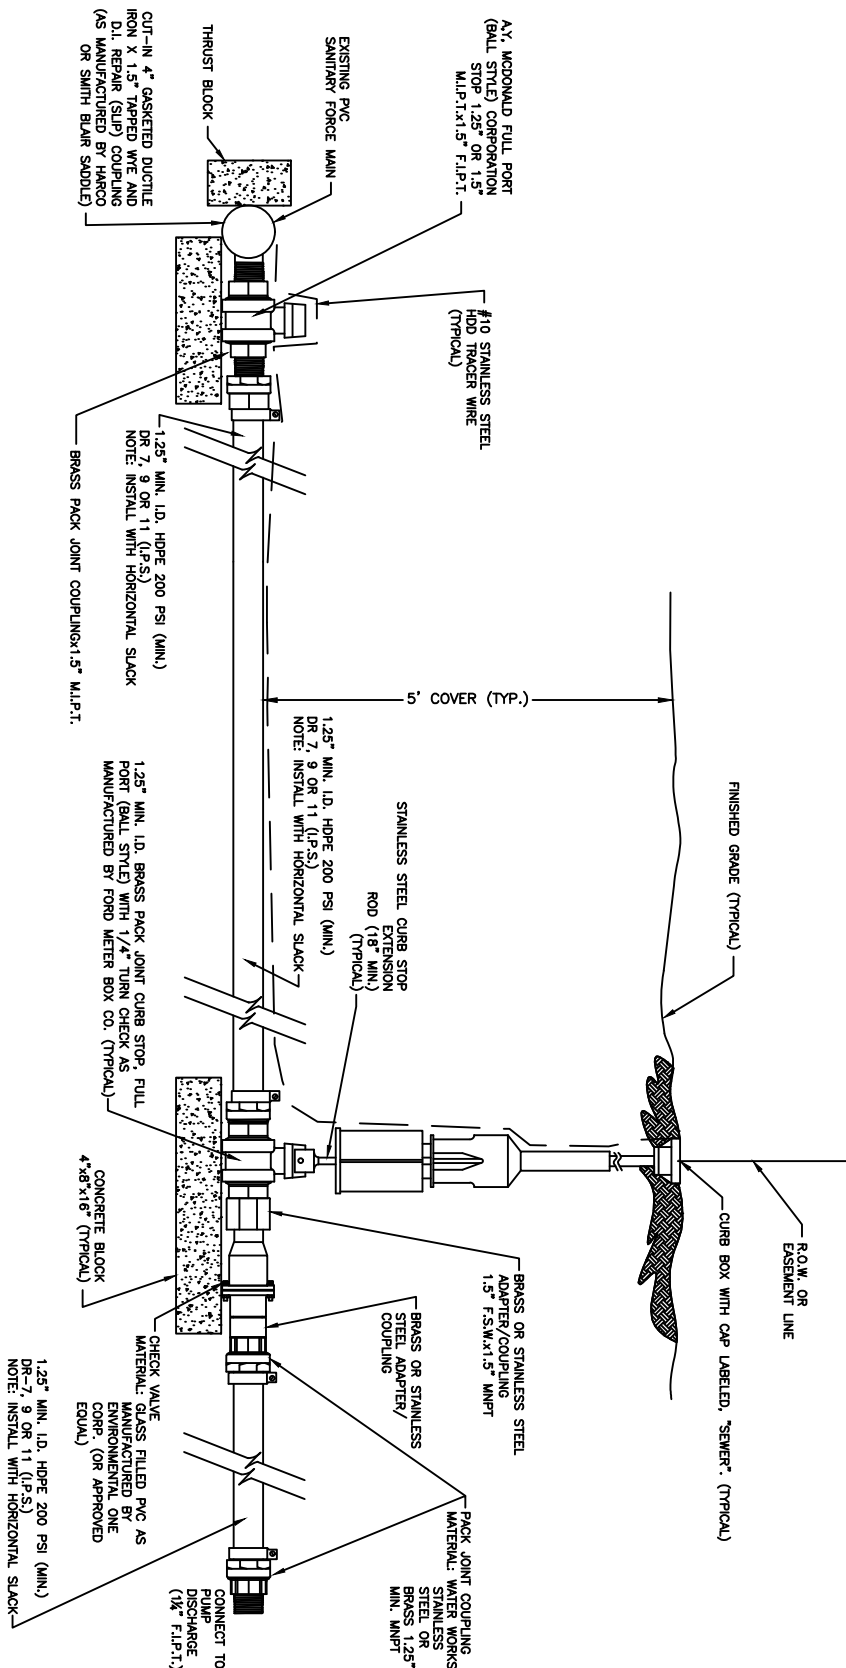

# INDOOR GRINDER PUMP TO SANITARY FORCE MAIN CONNECTION

NOT TO SCALE

SARATOGA COUNTY SEWER DISTRICT #1  
RESERVES THE RIGHT, AT OUR DISCRETION, TO  
CHANGE, MODIFY, ADD OR REMOVE PORTIONS  
OF THESE DETAIL SPECS AT ANY TIME



## SARATOGA COUNTY SEWER DISTRICT #1

1002 HUDSON RIVER ROAD, MECHANICVILLE, NEW YORK